



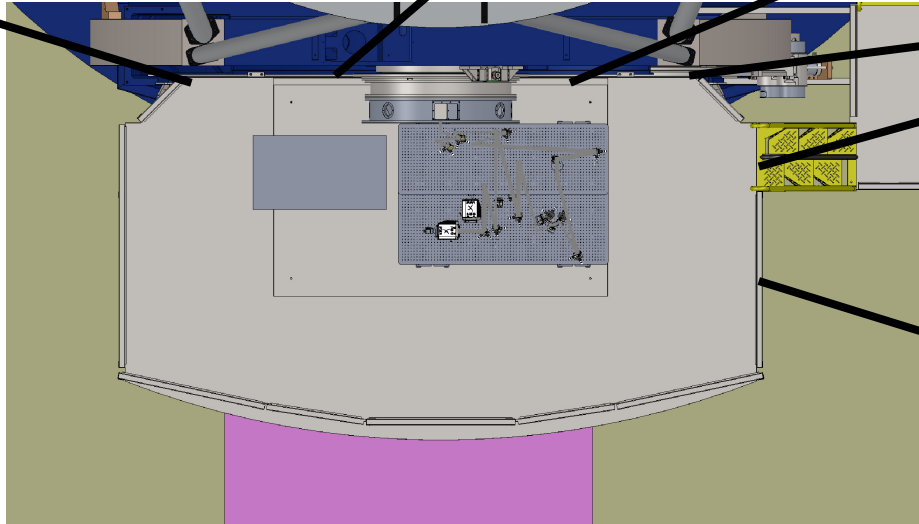

A.3 Electrical Interfaces

Jared R. Males

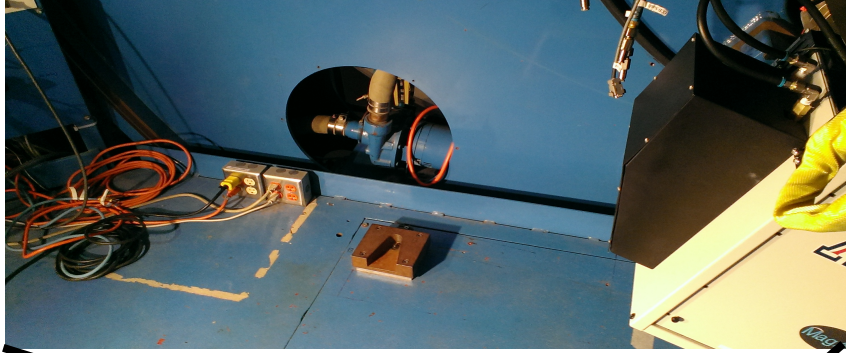

Existing NEMA 5-15 outlets on NASE
Orange = UPS (12x, 80 A total)
White = Direct (12x, 66 A total)



MagAO-X Needs:

- Electronics Rack: 4x 15A = on UPS
- 1x 15A on direct

Clio Electronics

- 1x UPS
- 1x Direct

